


FRAMING ELEVATIONS


12" 0' 1' 2' 3' 4'

NO. 9 GALVANIZED  
WIRE TIES, TWISTED

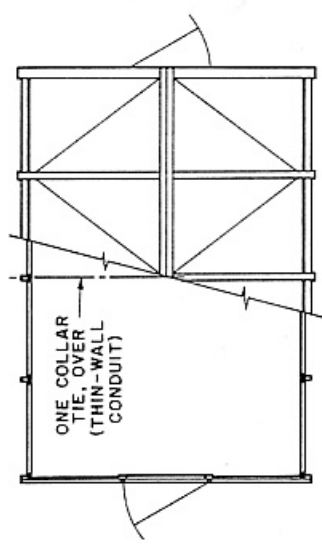


FRAMING PLAN

12" 0' 1' 2' 3' 4'

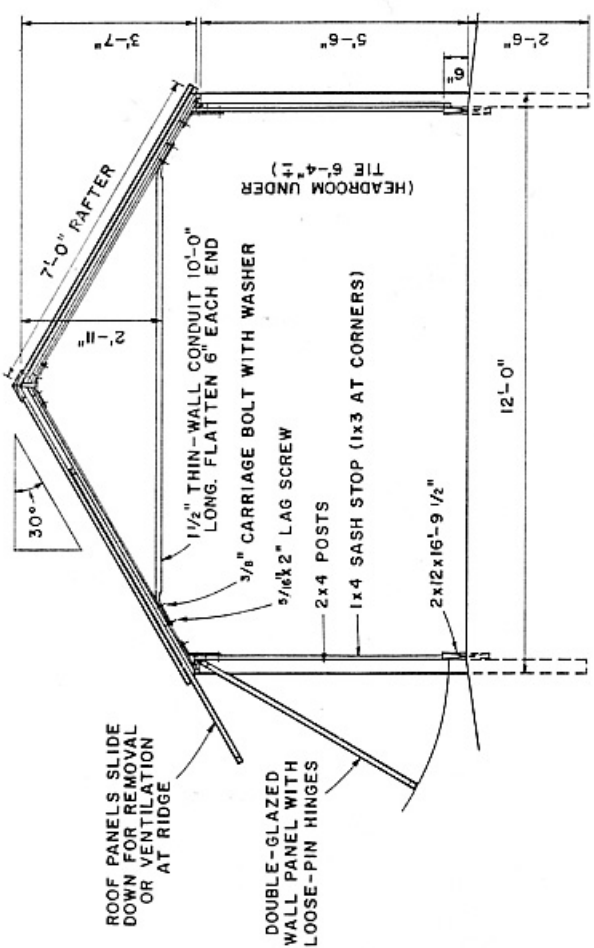


CROSS SECTION

12" 0' 1' 2'

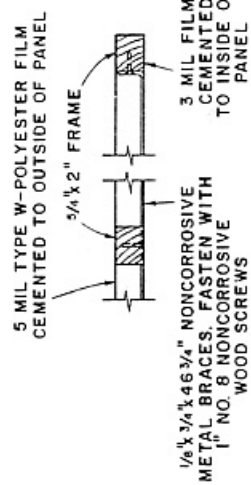


5 MIL TYPE W-POLYESTER FILM  
CEMENTED TO OUTSIDE OF PANEL

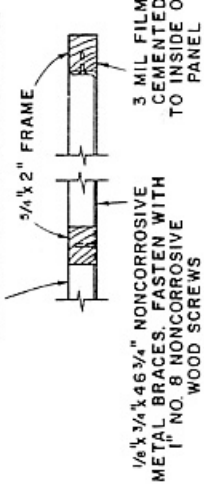


3/4" x 2" FRAME  
3 MIL FILM  
METAL BRACES, FASTENED WITH  
1" NO. 8 NONCORROSIVE  
WOOD SCREWS

TWO 3" NO. 10 SCREWS

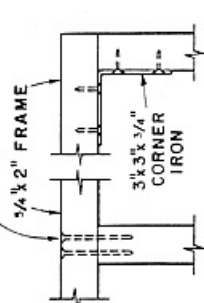

SECTION A-A  
NOT TO SCALE

6" 5" 4" 3" 2" 1" 0

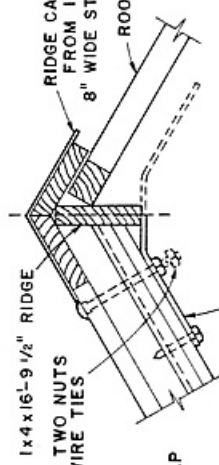

ROOF SASH PANEL

12" 6" 0' 1' 2'

4'-0"

ROOF PANELS 7'-0"

1x4x16'-9 1/2" RIDGE

8" WIDE STRIP OF SHEET METAL

ROOF PANEL (RAFTER NOT SHOWN)

3/8x1 1/2x12" F.B. WITH 3/8" DIA.  
CARRIAGE BOLT & 3/16x2" LAG  
SCREW TO EACH RAFTER

RIDGE DETAIL

USE LONGER BOLT AND TWO NUTS  
TO ANCHOR ENDS OF WIRE TIES

1x4 CAP

1x6 CAP

1x1

END WALL  
PANEL

2x3 RAFTER

END RAFTER

1x1 PANEL SUPPORTS WITH  
1/4" BEVEL FOR GUTTER

RAFTER DETAILS

2x4x16'-9 1/2" PLATE

8" GUTTER  
SPIKE

3/16x1 1/2x12" F.B.  
AT EACH POST


1x4 STOP

EAVE CONNECTIONS


NOTE:  
CONSULT LOCAL HEALTH AND  
BUILDING CODE AUTHORITIES  
BEFORE STARTING CONSTRUCTION.

COOPERATIVE EXTENSION WORK IN  
AGRICULTURE AND HOME ECONOMICS  
STATE OF TENNESSEE  
UNIVERSITY OF TENNESSEE  
AGRICULTURAL ENGINEERING DEPARTMENT  
UNITED STATES DEPARTMENT OF AGRICULTURE COOPERATING


|                    |     |      |              |
|--------------------|-----|------|--------------|
| USDA               | '76 | 6251 | SHEET 1 OF 2 |
| PLASTIC GREENHOUSE |     |      |              |

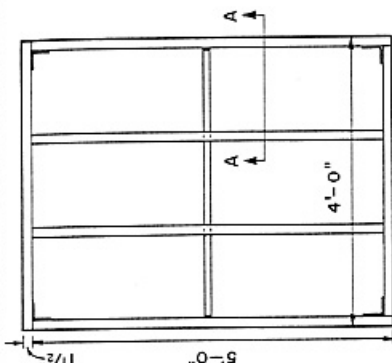


**SIDE WALL SASH PANEL**  
EIGHT REQ'D

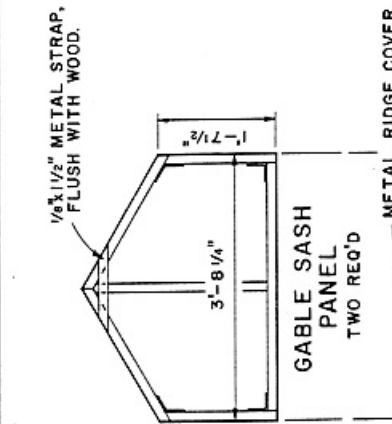

**GABLE SASH PANEL**  
TWO REQ'D

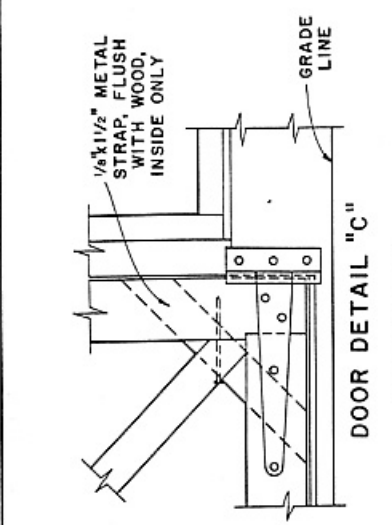


**DOOR DETAIL "C"**

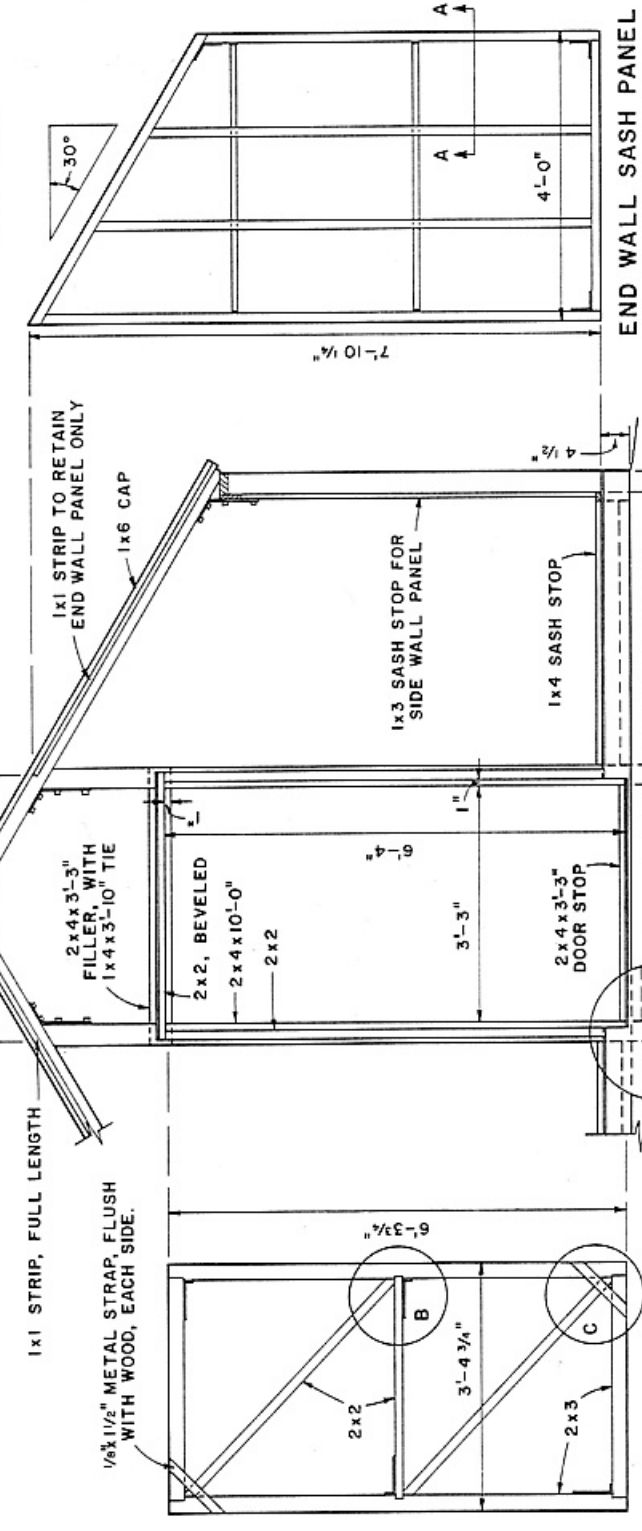

**END WALL SASH PANEL**  
FOUR REQ'D. TWO RIGHT & TWO LEFT

1x3 SASH STOP FOR SIDE WALL PANEL  
1x4 SASH STOP  
2x12 x 12'-0" NOTCHED 3 1/2" x 3'-5" FOR DOOR. BEVEL TOP EDGE FOR DRAINAGE.


**END WALL FRAMING**

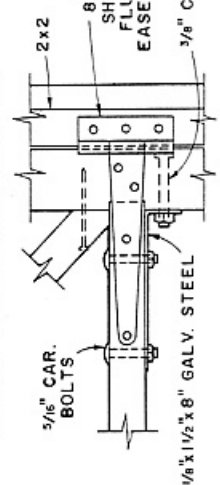

**DOOR DETAIL "B"**

APPLY FILM TO INSIDE FIRST. OUTER FILM SHALL EXTEND OVER TOP RAIL AND LAP THE TOP EDGE OF THE INNER FILM.

8" GALVANIZED T-HINGE WITH BRASS PIN. PIN SHOULD BE REMOVABLE. INSET SO LEAVES ARE FLUSH WITH THE SURFACE OF WOOD MEMBERS FOR EASE IN APPLYING OR REPLACING THE PLASTIC FILM.

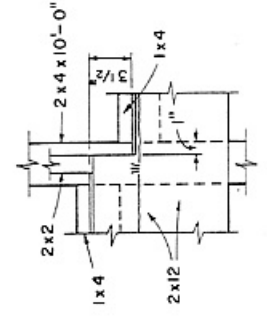

**SILL DETAIL "A"**

**NOTES:**  
THE ROOF PANELS ARE HELD IN CLOSED OR PARTLY OPEN POSITIONS BY 6d DOUBLE-HEADED NAILS IN HOLES DRILLED THROUGH LOWER END OF RAFTER CAP INTO PANEL FRAME.  
INSTALL RESILIENT WEATHER STRIPPING TO CLOSE THE SPACE BETWEEN THE PLATES AND ROOF PANELS.  
ALL WOOD PARTS TO BE TREATED, AFTER CUTTING, WITH A COPPER-NAPHTHENE PRESERVATIVE.  
ALL METAL PARTS SHOULD BE OF NON-CORROSIVE METAL OR HOT-DIP GALVANIZED STEEL.



COOPERATIVE EXTENSION WORK IN  
AGRICULTURE AND HOME ECONOMICS  
STATE OF TENNESSEE  
UNIVERSITY OF TENNESSEE  
AGRICULTURAL ENGINEERING DEPARTMENT  
UNITED STATES DEPARTMENT OF AGRICULTURE COOPERATING